


Pegler Valve

Brass chrome plated ball valve with tee, full bore. XPress ends for copper/carbon steel/stainless steel tube


PS500T Ball valve

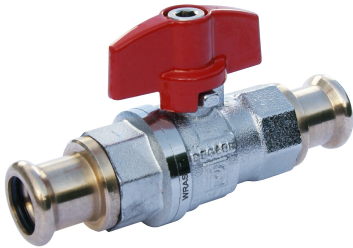

General Information

Size	Pattern No.	Pack 1 Qty	Pack 2 Qty	Code	Barcode	Price (£) each ex VAT	Discontinued	Date Discontinued
15mm	PS500T	1	10	243301	5022050565877	£28.24		
18mm	PS500T	1	10	243302	5022050565808	Disc(Stock available)	Discontinued	17/09/2021
22mm	PS500T	1	10	243303	5022050565884	£42.87		
28mm	PS500T	1	5	243304	5022050565891	£58.93		

PS500T Ball valve

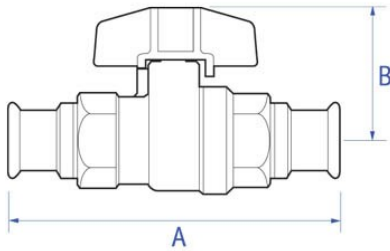

Dimensions

Code	Description	A	B
243301	DN15/15mm PS500T	105	40
243303	DN20/22mm PS500T	115	51
243304	DN25/28mm PS500T	131	55

Pegler Yorkshire reserve the right to change specifications

Flow Rate

Size	Pattern No.	Code	Kv m3/h
15mm	PS500T	243301	17.00
22mm	PS500T	243303	41.00
28mm	PS500T	243304	70.00

Pegler Yorkshire reserve the right to change specifications

Pressure and Temperature

Description	Minimum Operating Pressure (bar)	Maximum Cold Working Pressure (bar)	Maximum Hot Working Pressure (bar)
PS500T Ball Valve	No minimum operating pressure.	16 bar up to 100oC	16 bar up to 100oC

Care and Maintenance

Care

No regular aesthetic care is required for this product

Maintenance

A regular maintenance program is the most efficient method of ensuring longer term operational efficiency of the selected valve. Such a program would need to include a risk assessment and a planned procedure of how the maintenance will be carried out. The possibility of operational limits being exceeded and the potential hazards ensuring must be considered as part of this assessment. This should be implemented to

include visual checks on the valve's condition and any development of unforeseen conditions, which could lead to failure. The correct fitting tools and equipment should be used for valve maintenance work. Separate means of draining the pipe work must be provided when carrying out any maintenance to valves. Where there may be any system debris this could be collected and /or filtered by installation of the appropriate protective device.

For further help please contact your local engineer.

If your product is under warranty please contact the Service Support Team on: 0800 1560050

Regulations

Regulations

THE PRESSURE EQUIPMENT DIRECTIVE 97/23/EC and CE MARKING

The Pressure Equipment Regulations 1999 (SI 1999/2001) have now been introduced into United Kingdom law.

Valves with a maximum allowable pressure greater than 0.5 bar are covered by these new Regulations. Valves are categorised according to their maximum working pressure, size and rising level of hazard. The level of hazard varies according to the fluid being carried. Fluids are classified as Group 1, dangerous fluids or Group 2, all other fluids including steam. The Categories designated are SEP (sound engineering practice). Valves up to and including 25mm (1") are designated SEP regardless of the fluid group. Those identified as having increased hazard are Categorised as, I, II, III or IV. All valves designated as SEP do not bear the CE mark nor require a Declaration of Conformity. Categories I, II, III or IV carry the CE mark and require a Declaration of Conformity. Valves classified from the piping chart would not be included in Category IV.

Size Pattern No. Code PED Categorisation

15mm PS500T	243301 SEP
22mm PS500T	243303 SEP
28mm PS500T	243304 SEP

Pegler Yorkshire reserve the right to change specifications